


Particle Size Distribution Report

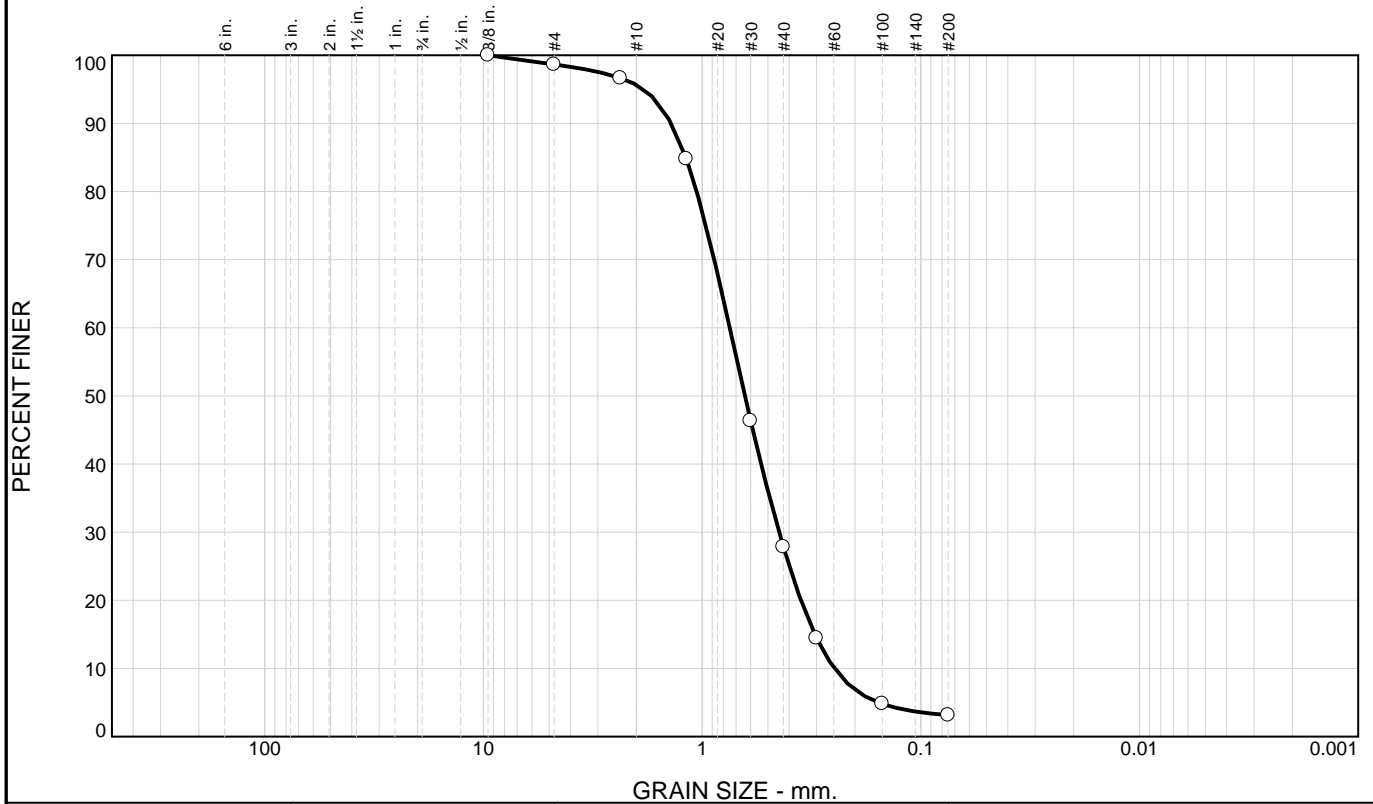

% +3"	% Gravel		% Sand			% Fines	
	Coarse	Fine	Coarse	Medium	Fine	Silt	Clay
0	0	1	3	68	25	3	

SIEVE SIZE	PERCENT FINER	SPEC.* PERCENT	PASS? (X=NO)
.375	100		
#4	99		
#8	97		
#16	85		
#30	46		
#40	28		
#50	14		
#100	5		
#200	3.1		

Material Description

Concrete fine aggregate

Atterberg Limits (ASTM D 4318)

PL= N/A LL= N/A PI= N/A

Classification

USCS= AASHTO=

Coefficients

D₈₅= 1.1863 D₆₀= 0.7475 D₅₀= 0.6370
 D₃₀= 0.4448 D₁₅= 0.3056 D₁₀= 0.2487
 C_u= 3.01 C_c= 1.06

Date Tested: 6/12/09 **Tested By:** G. Jadrych

Remarks

Sampled and delivered by KW Enterprises

* ASTM C 33 - Fine Aggregate

Sample No.: 2089-B **Source of Sample:** Decker Pit **Date Sampled:** 6/12/09
Location: **Title:** Laboratory Manager **Elev./Depth:**
Checked By: G. Denten

	<p>Client: KW Enterprises</p> <p>Project: KW Enterprises Misc. Testing</p> <p>Project No.: 51819MT</p> <p style="text-align: right;">Figure</p>
--	---